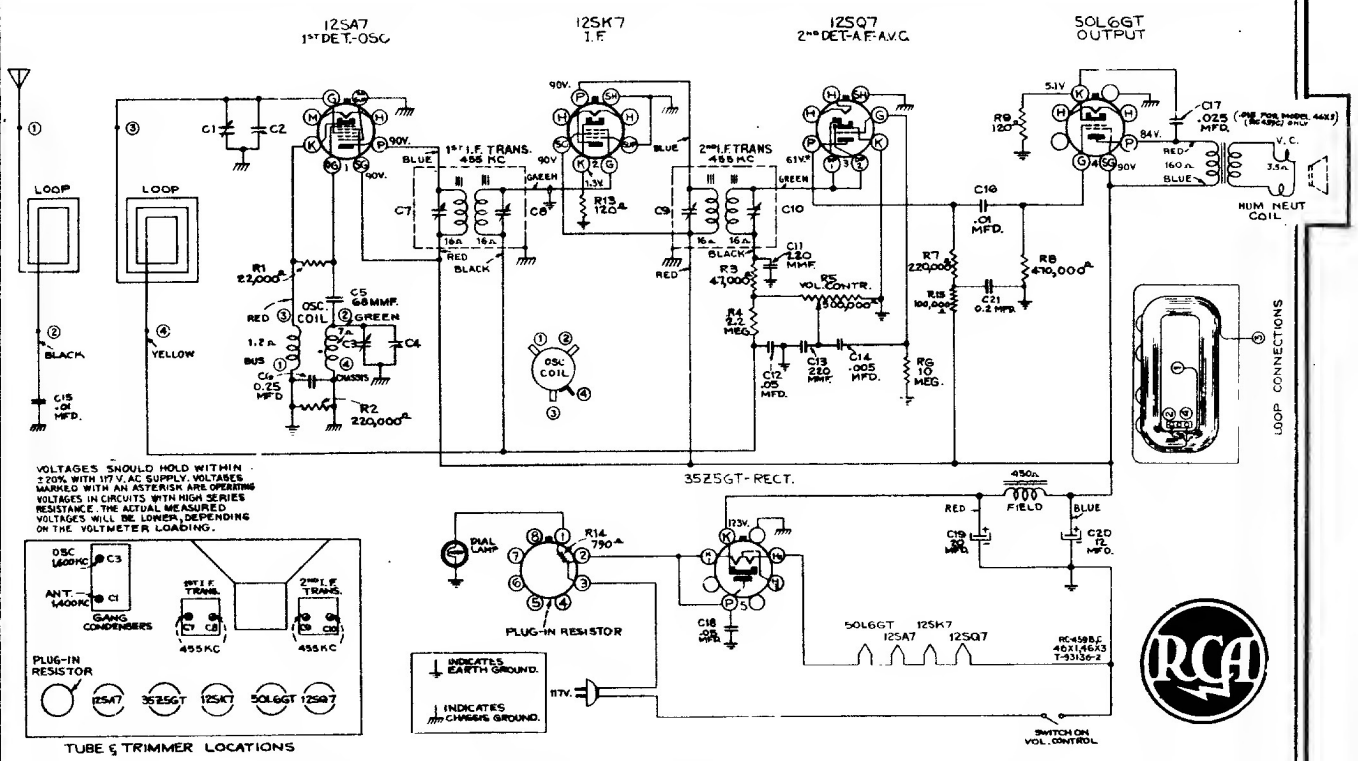

VOLTAGES SHOULD HOLD WITHIN ±20% WITH 117 V. AC SUPPLY. VOLTAGES MARKED WITH AN ASTERISK ARE OPERATING VOLTAGES IN CIRCUITS WITH HIGH SERIES RESISTANCE. THE ACTUAL MEASURED VOLTAGES WILL BE LOWER, DEPENDING ON THE VOLTMETER LOADING.

Models 46X1, 46X2 and 46X3

Chassis Nos. 459B and 459C

Models 46X11, 46X12, and 46X13

Chassis Nos. RC456 and RC456A

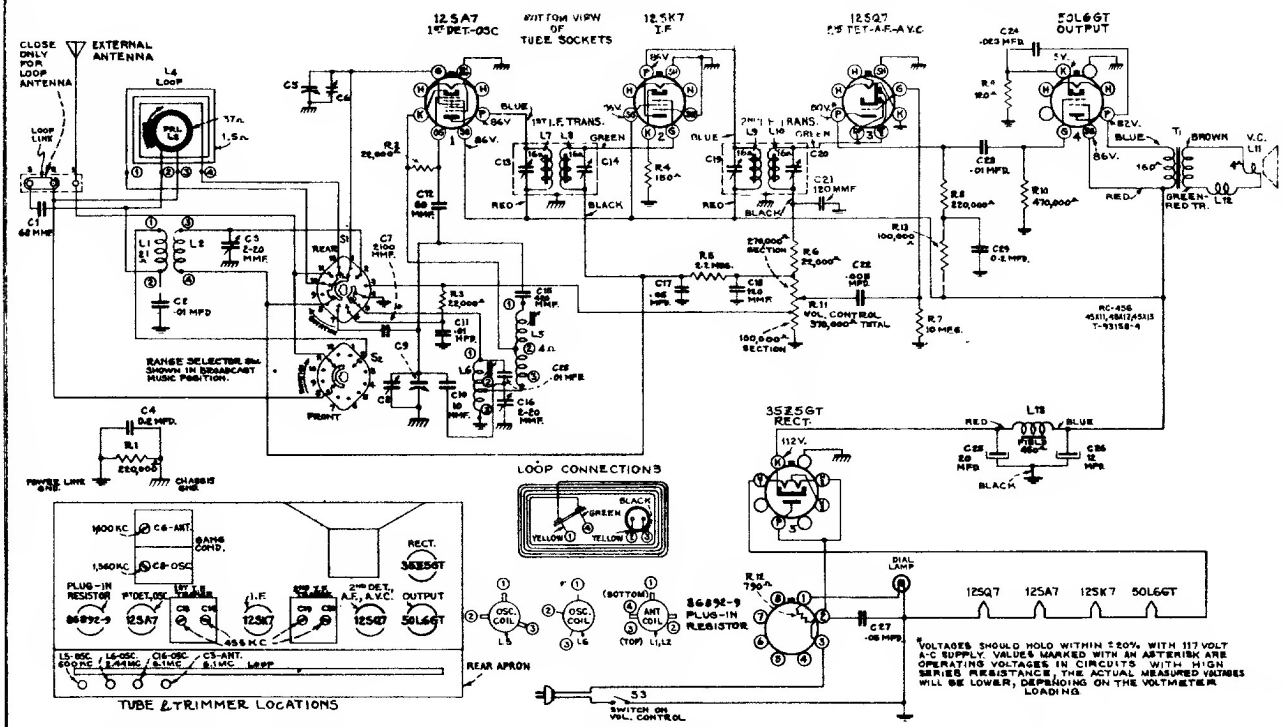

* VOLTAGES SHOULD HOLD WITHIN ±20% WITH 117 VOLT A-C SUPPLY. VALUES MARKED WITH AN ASTERISK ARE OPERATING VOLTAGES IN CIRCUITS WITH HIGH SERIES RESISTANCE. THE ACTUAL MEASURED VOLTAGES WILL BE LOWER, DEPENDING ON THE VOLTMETER LOADING.